


Note: to purchaser all sales of Huaci products are subject to our standard terms and conditions and the limited warranties thereunder.

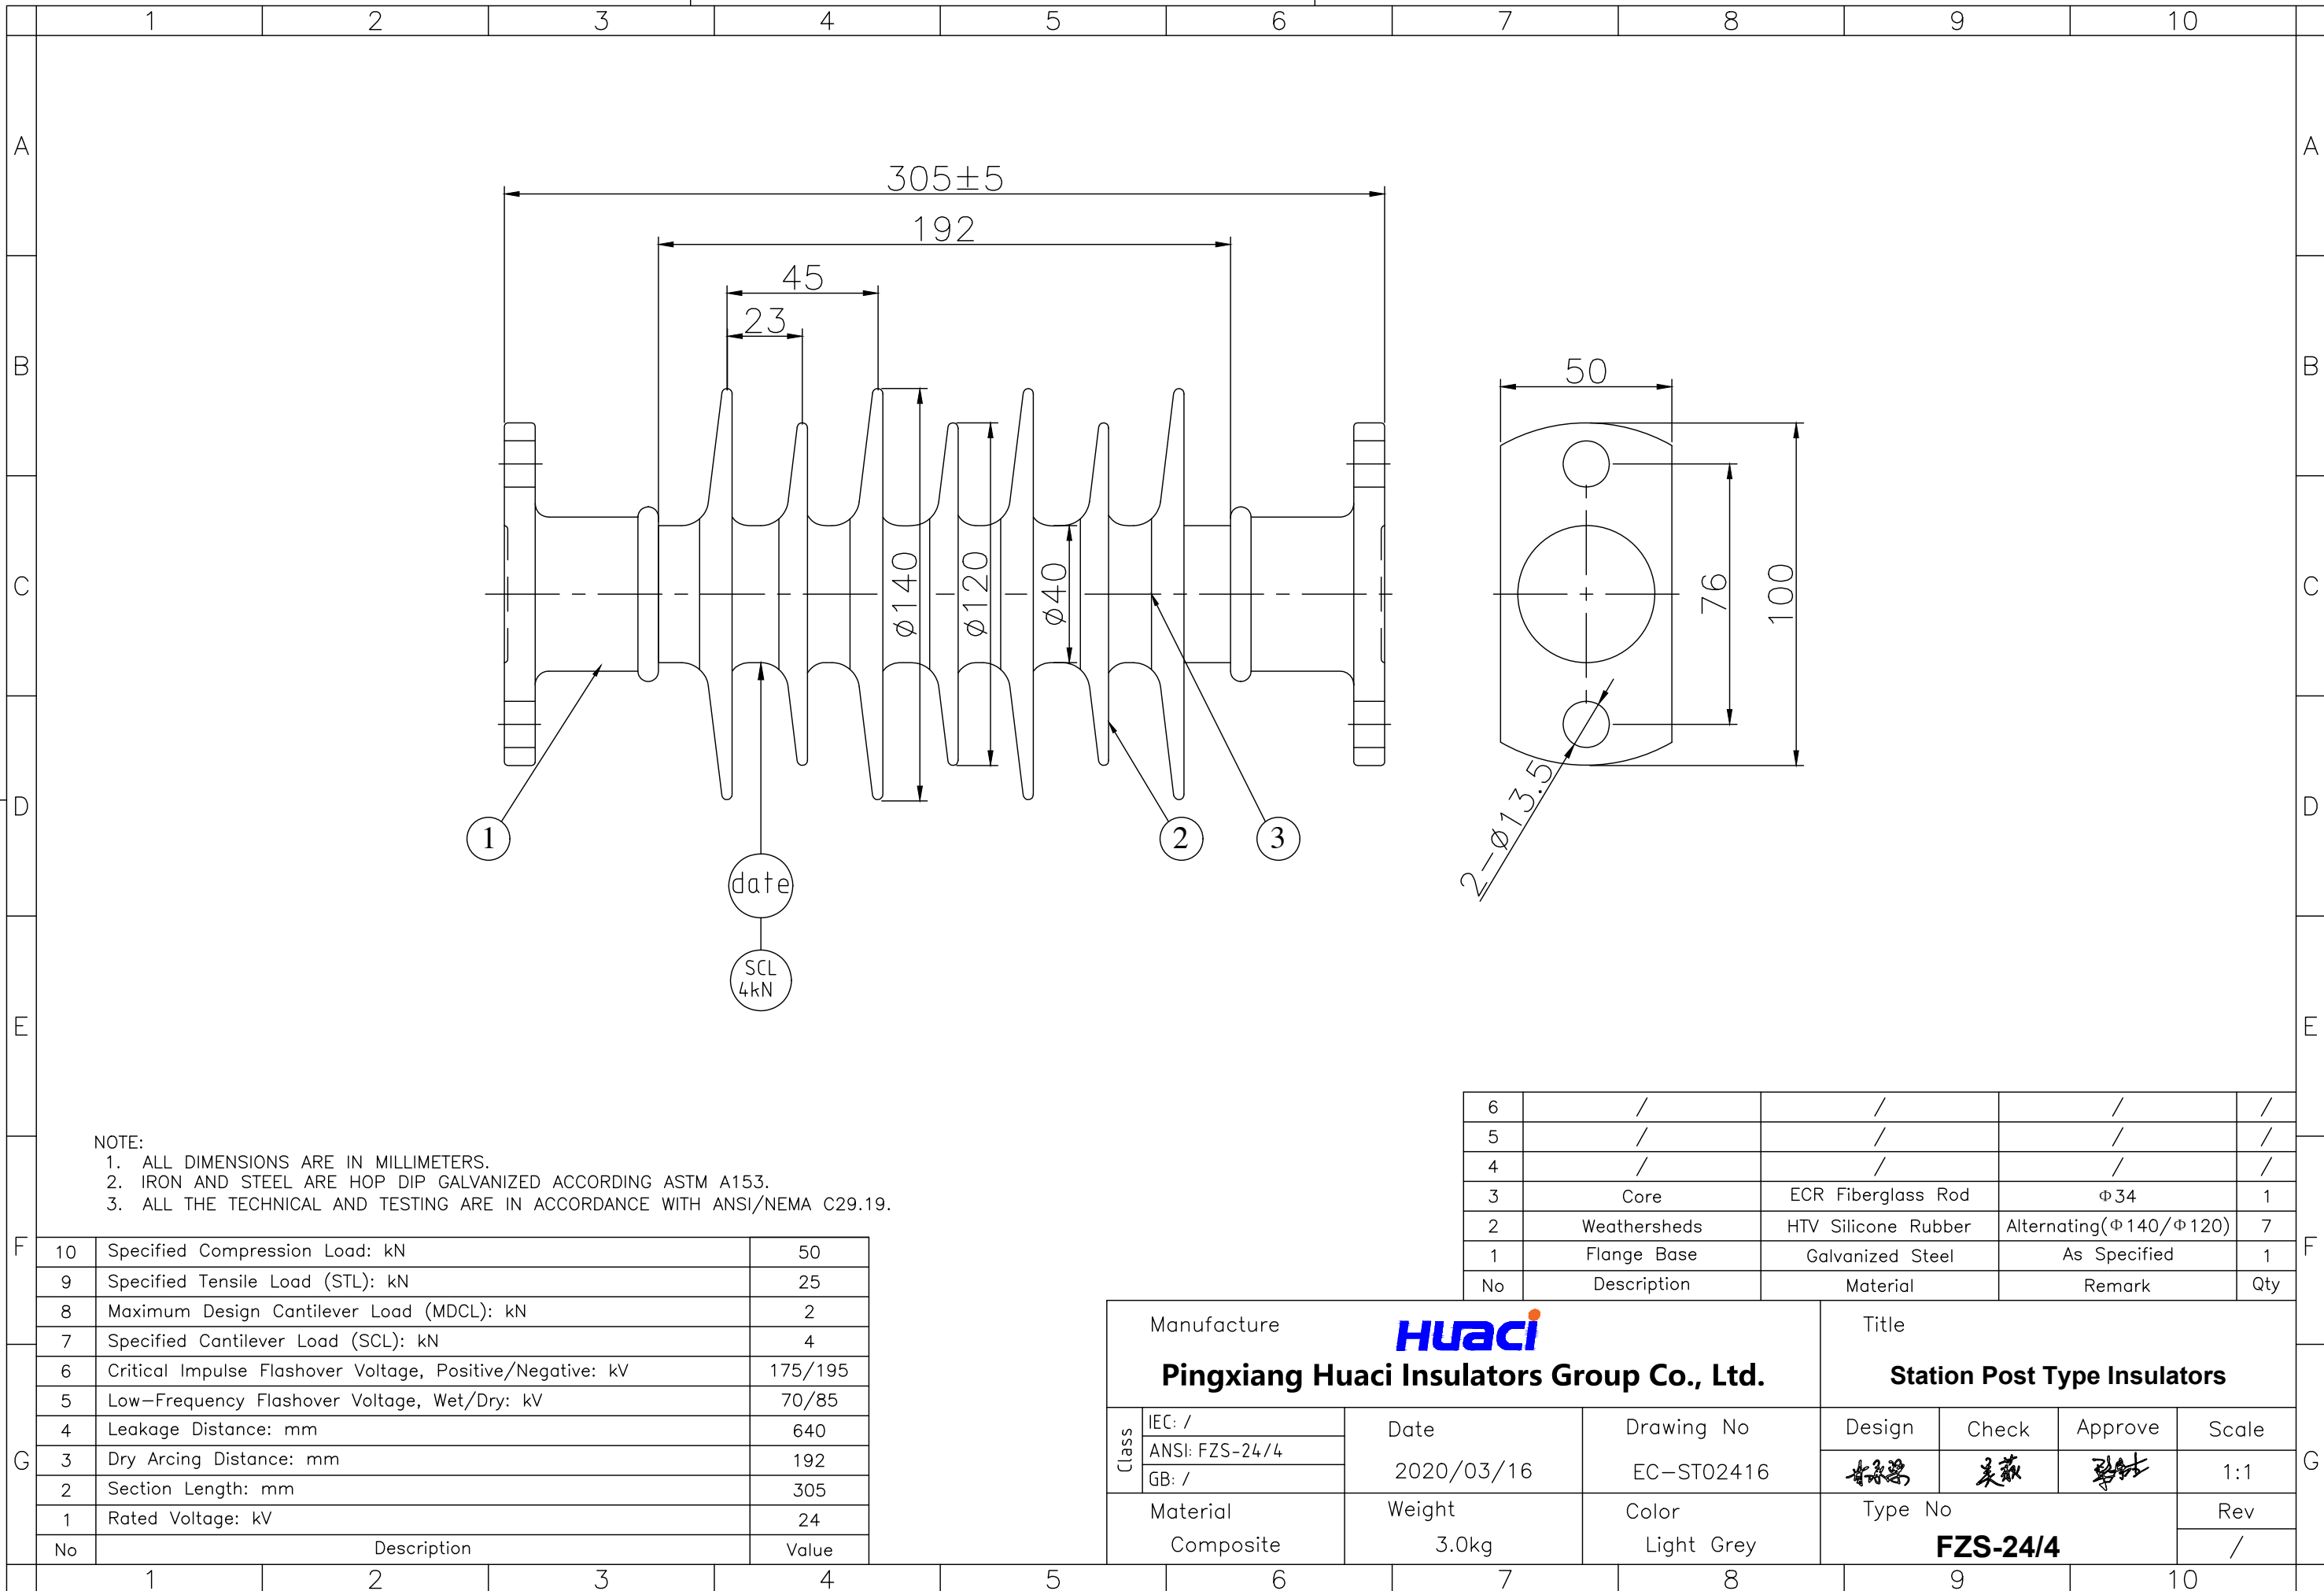

NOTE:
 1. ALL DIMENSIONS ARE IN MILLIMETERS.
 2. IRON AND STEEL ARE HOP DIP GALVANIZED ACCORDING ASTM A153.
 3. ALL THE TECHNICAL AND TESTING ARE IN ACCORDANCE WITH ANSI/NEMA C29.19.

6	/	/	/	/
5	/	/	/	/
4	/	/	/	/
3	Core	ECR Fiberglass Rod	φ34	1
2	Weathersheds	HTV Silicone Rubber	Alternating(φ140/φ120)	7
1	Flange Base	Galvanized Steel	As Specified	1
No	Description	Material	Remark	Qty

10	Specified Compression Load: kN	50
9	Specified Tensile Load (STL): kN	25
8	Maximum Design Cantilever Load (MDCL): kN	2
7	Specified Cantilever Load (SCL): kN	4
6	Critical Impulse Flashover Voltage, Positive/Negative: kV	175/195
5	Low-Frequency Flashover Voltage, Wet/Dry: kV	70/85
4	Leakage Distance: mm	640
3	Dry Arcing Distance: mm	192
2	Section Length: mm	305
1	Rated Voltage: kV	24
No	Description	Value

Manufacture HUACI Pingxiang Huaci Insulators Group Co., Ltd.			Title Station Post Type Insulators				
Class	IEC: /	Date	Drawing No	Design	Check	Approve	Scale
	ANSI: FZS-24/4	2020/03/16	EC-ST02416	杨忠	吴薇	张	1:1
Material	Composite	Weight	Color	Type No		Rev	
		3.0kg	Light Grey	FZS-24/4		/	